


Urządzenie:

Szkolna 2, Grupa SP

Temperatura

Data	Wartość
2024-04-01	16.32
2024-04-02	12.45
2024-04-03	9.55
2024-04-04	11.7
2024-04-05	14.86
2024-04-06	16.33
2024-04-07	19.43
2024-04-08	20.63
2024-04-09	21.72
2024-04-10	14.08
2024-04-11	14.14
2024-04-12	15.61
2024-04-13	17.49
2024-04-14	15.7
2024-04-15	11.11
2024-04-16	8.34
2024-04-17	7.47
2024-04-18	6.56
2024-04-19	7.18
2024-04-20	6.28
2024-04-21	4.57
2024-04-22	4.01
2024-04-23	6.33
2024-04-24	8.57
2024-04-25	8.16
2024-04-26	10.41
2024-04-27	15.24
2024-04-28	17.52
2024-04-29	19.9

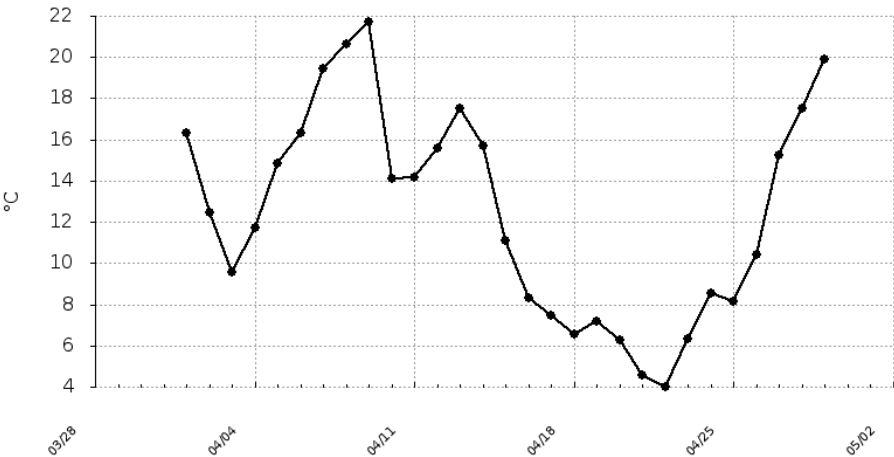


Raport wygenerowano: 2024-05-09 14:15

Urządzenie:

Szkolna 2, Grupa SP

Wilgotność

Data	Wartość
2024-04-01	71.16
2024-04-02	76.86
2024-04-03	76.26
2024-04-04	73.12
2024-04-05	72.65
2024-04-06	72.46
2024-04-07	69.02
2024-04-08	69.56
2024-04-09	65.1
2024-04-10	69.36
2024-04-11	62.69
2024-04-12	69.7
2024-04-13	67.08
2024-04-14	61.94
2024-04-15	66.53
2024-04-16	71.48
2024-04-17	70.22
2024-04-18	72.28
2024-04-19	71.69
2024-04-20	74.44
2024-04-21	66.55
2024-04-22	65.18
2024-04-23	62.85
2024-04-24	61.85
2024-04-25	69.25
2024-04-26	61.04
2024-04-27	60.25
2024-04-28	60.15
2024-04-29	63.01

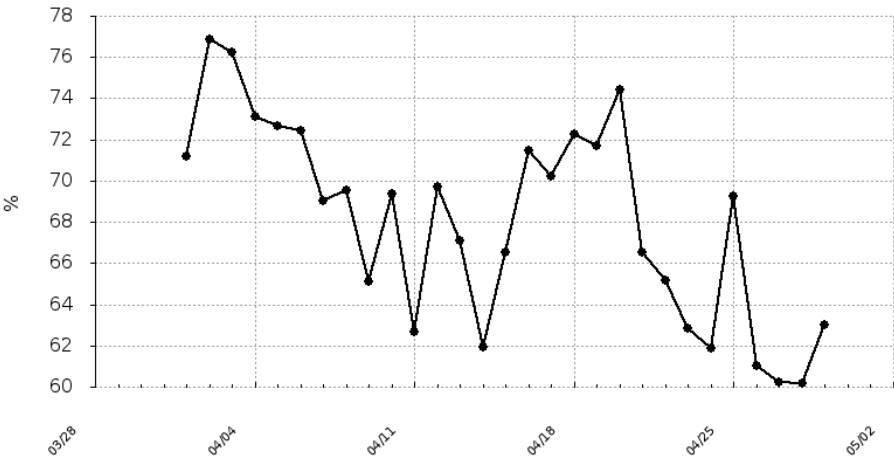


Urządzenie:

Szkolna 2, Grupa SP

Ciśnienie

Data	Wartość
2024-04-01	992.47
2024-04-02	995.99
2024-04-03	1001.84
2024-04-04	1005.57
2024-04-05	1007.86
2024-04-06	1010.85
2024-04-07	1011.83
2024-04-08	1008.3
2024-04-09	1004.6
2024-04-10	1018.44
2024-04-11	1027.27
2024-04-12	1024.48
2024-04-13	1017.79
2024-04-14	1010.25
2024-04-15	1004.13
2024-04-16	994.46
2024-04-17	1001
2024-04-18	1007.82
2024-04-19	1002.44
2024-04-20	1006.39
2024-04-21	1017.58
2024-04-22	1018.15
2024-04-23	1015.53
2024-04-24	1004.71
2024-04-25	1001.99
2024-04-26	1005.95
2024-04-27	1009.73
2024-04-28	1013.09
2024-04-29	1017.45

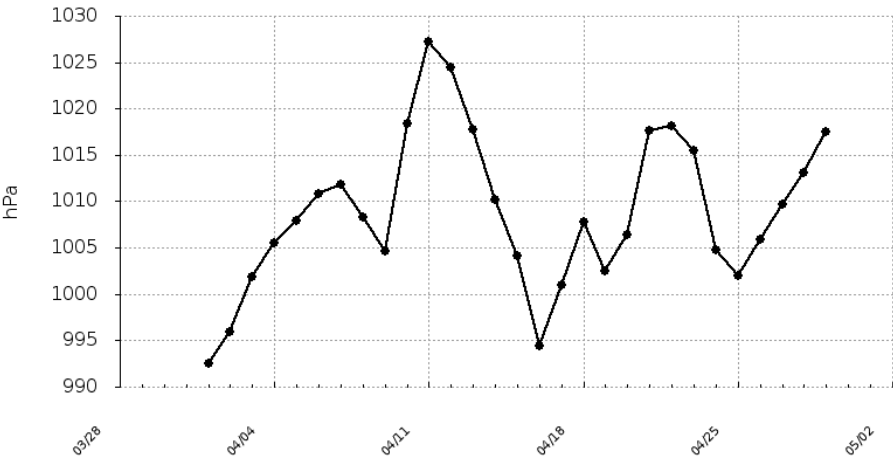


Raport wygenerowano: 2024-05-09 14:15

Urządzenie:

Szkolna 2, Grupa SP

Pyły zawieszone o średnicy mniejszej 2.5 mikrometrów

Data	Wartość
2024-04-01	7.14
2024-04-02	2.16
2024-04-03	2.43
2024-04-04	6.61
2024-04-05	2.83
2024-04-06	4.62
2024-04-07	7.6
2024-04-08	7.64
2024-04-09	6.41
2024-04-10	3.14
2024-04-11	3.46
2024-04-12	3.57
2024-04-13	5.09
2024-04-14	3.09
2024-04-15	3.36
2024-04-16	4.09
2024-04-17	2.46
2024-04-18	3.63
2024-04-19	5.78
2024-04-20	5.01
2024-04-21	3.61
2024-04-22	3.97
2024-04-23	10.8
2024-04-24	13.75
2024-04-25	15.58
2024-04-26	9.88
2024-04-27	9.54
2024-04-28	7.36
2024-04-29	6.39

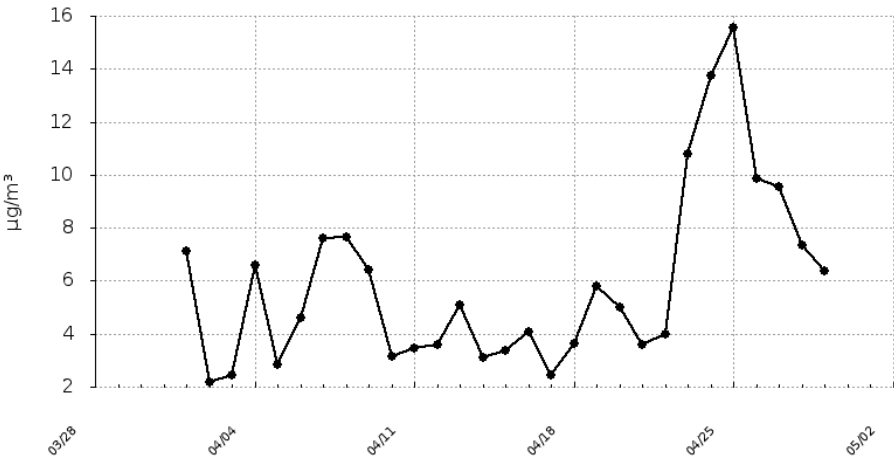


Raport wygenerowano: 2024-05-09 14:15

Urządzenie:

Szkolna 2, Grupa SP

Pyły zawieszone o średnicy mniejszej niż 10 mikrometrów

Data	Wartość
2024-04-01	12.58
2024-04-02	3.86
2024-04-03	4.38
2024-04-04	11.4
2024-04-05	4.98
2024-04-06	8.22
2024-04-07	13.49
2024-04-08	13.58
2024-04-09	11.36
2024-04-10	5.47
2024-04-11	6.24
2024-04-12	6.28
2024-04-13	9.11
2024-04-14	5.47
2024-04-15	5.68
2024-04-16	7.34
2024-04-17	4.45
2024-04-18	6.55
2024-04-19	10.33
2024-04-20	8.98
2024-04-21	6.48
2024-04-22	7.17
2024-04-23	18.24
2024-04-24	23.88
2024-04-25	26.64
2024-04-26	17.26
2024-04-27	16.9
2024-04-28	13.1
2024-04-29	11.46

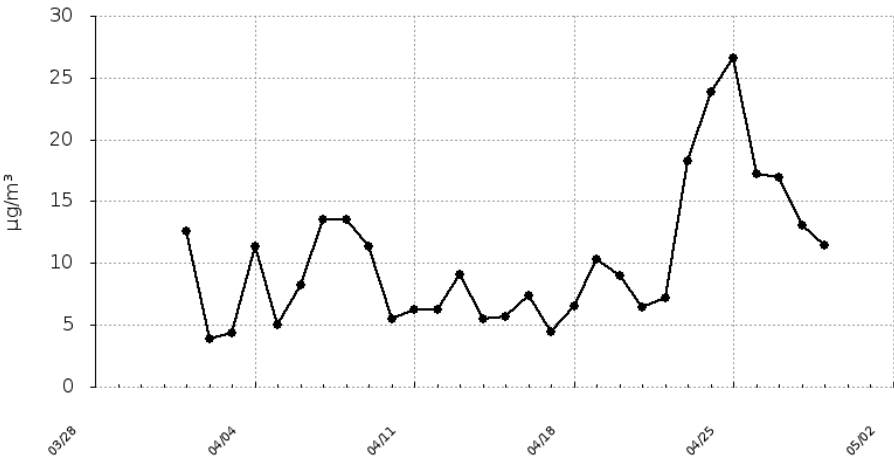


Raport wygenerowano: 2024-05-09 14:15

Urządzenie:

Szkolna 2, Grupa SP

Pyły zawieszone o średnicy mniejszej niż 1 mikrometr

Data	Wartość
2024-04-01	3.6
2024-04-02	1.11
2024-04-03	1.25
2024-04-04	3.27
2024-04-05	1.42
2024-04-06	2.32
2024-04-07	3.86
2024-04-08	3.88
2024-04-09	3.28
2024-04-10	1.54
2024-04-11	1.78
2024-04-12	1.81
2024-04-13	2.59
2024-04-14	1.56
2024-04-15	1.65
2024-04-16	2.11
2024-04-17	1.24
2024-04-18	1.87
2024-04-19	2.96
2024-04-20	2.56
2024-04-21	1.84
2024-04-22	2.02
2024-04-23	5.23
2024-04-24	6.91
2024-04-25	7.78
2024-04-26	4.86
2024-04-27	4.89
2024-04-28	3.74
2024-04-29	3.23

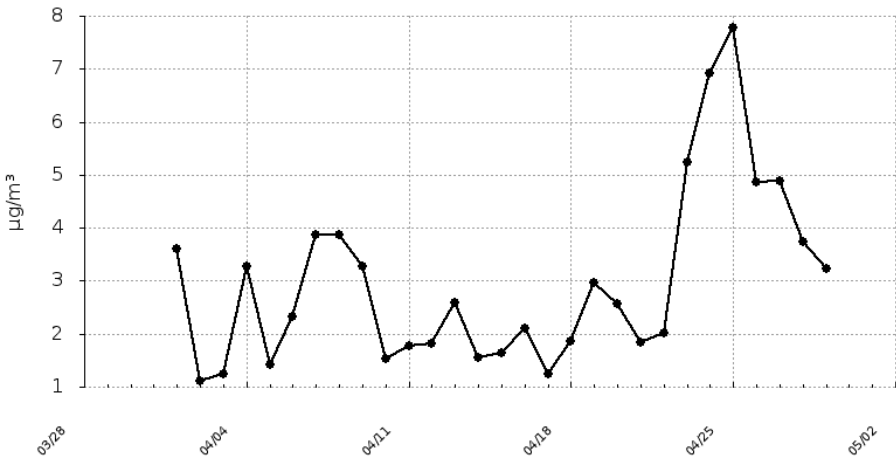

Raport wygenerowano: 2024-05-09 14:15