


Urządzenie:

Szkolna 2, Grupa SP

Temperatura

Data	Wartość
2024-03-01	11.29
2024-03-02	11.76
2024-03-03	11.04
2024-03-04	7.62
2024-03-05	5.29
2024-03-06	5.29
2024-03-07	4.08
2024-03-08	3.71
2024-03-09	5.47
2024-03-10	8.34
2024-03-11	8.64
2024-03-12	9.26
2024-03-13	9.38
2024-03-14	10.72
2024-03-15	13.26
2024-03-16	11.67
2024-03-17	4.6
2024-03-18	2.8
2024-03-19	5.14
2024-03-20	7.11
2024-03-21	10.36
2024-03-22	10.33
2024-03-23	7.84
2024-03-24	6.28
2024-03-25	7.33
2024-03-26	8.59
2024-03-27	13.04
2024-03-28	12.74
2024-03-29	13.37
2024-03-30	17.15

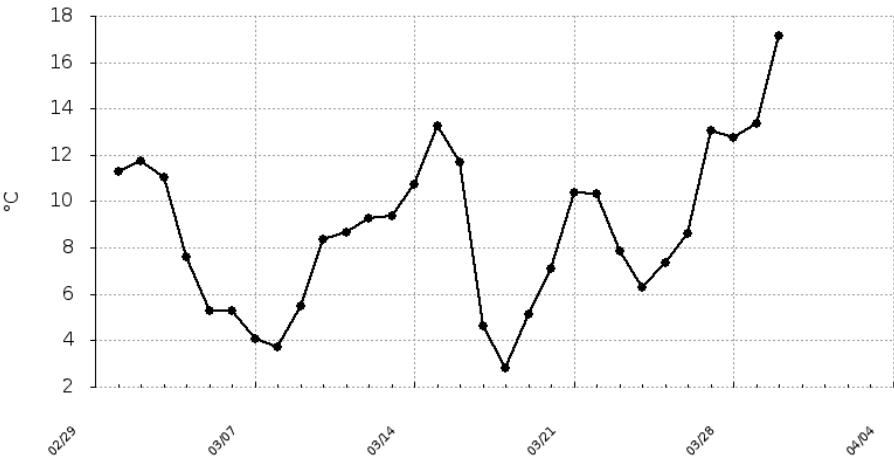


Raport wygenerowano: 2024-05-09 14:14

Urządzenie:

Szkolna 2, Grupa SP

Wilgotność

Data	Wartość
2024-03-01	87.98
2024-03-02	87.16
2024-03-03	81.07
2024-03-04	81.77
2024-03-05	81.65
2024-03-06	74.38
2024-03-07	71.46
2024-03-08	77.13
2024-03-09	83.89
2024-03-10	80.21
2024-03-11	77.95
2024-03-12	89.44
2024-03-13	84.44
2024-03-14	80.11
2024-03-15	79.76
2024-03-16	84.83
2024-03-17	84.01
2024-03-18	84.15
2024-03-19	80.69
2024-03-20	78.36
2024-03-21	85.63
2024-03-22	89.03
2024-03-23	96.02
2024-03-24	85.67
2024-03-25	87.1
2024-03-26	73.53
2024-03-27	64.45
2024-03-28	71.57
2024-03-29	62.08
2024-03-30	66.38

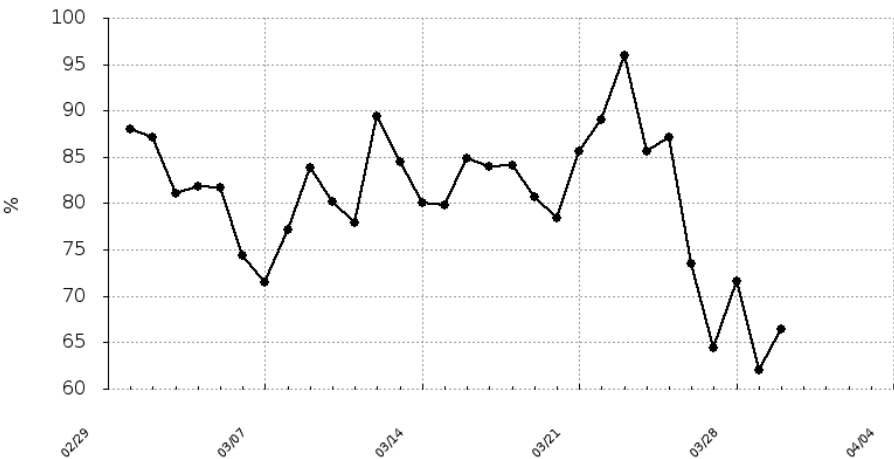


Urządzenie:

Szkolna 2, Grupa SP

Ciśnienie

Data	Wartość
2024-03-01	1006.51
2024-03-02	1005.84
2024-03-03	1004.96
2024-03-04	1007.49
2024-03-05	1012.17
2024-03-06	1019.55
2024-03-07	1022.79
2024-03-08	1018.49
2024-03-09	1010.78
2024-03-10	1005.14
2024-03-11	1003.96
2024-03-12	1008.44
2024-03-13	1012.45
2024-03-14	1011.69
2024-03-15	1007.65
2024-03-16	1008.1
2024-03-17	1016.38
2024-03-18	1017.09
2024-03-19	1019.9
2024-03-20	1018.14
2024-03-21	1014.67
2024-03-22	1010.27
2024-03-23	999.99
2024-03-24	997.94
2024-03-25	998.68
2024-03-26	1000.08
2024-03-27	989.74
2024-03-28	986.72
2024-03-29	998.41
2024-03-30	998.4

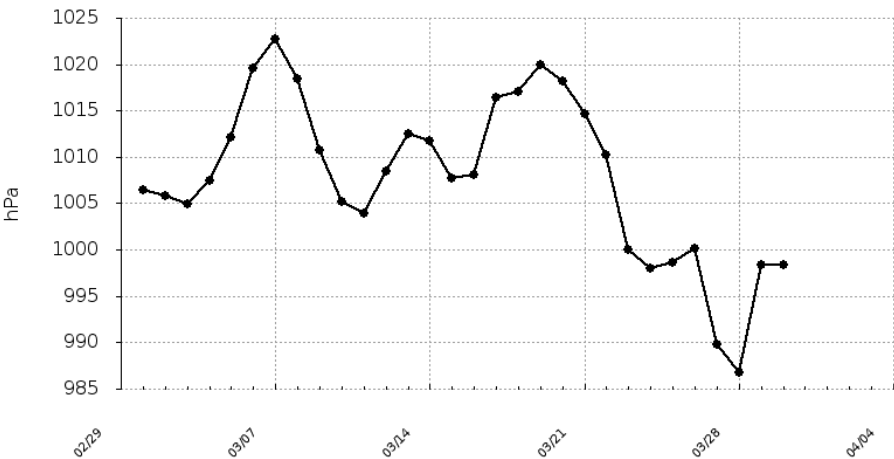

Urządzenie:

Szkolna 2, Grupa SP

Pyły zawieszone o średnicy mniejszej 2.5 mikrometrów

Data	Wartość
2024-03-01	32.42
2024-03-02	28.51
2024-03-03	26.76
2024-03-04	24.41
2024-03-05	19.29
2024-03-06	23.66
2024-03-07	21.11
2024-03-08	30.67
2024-03-09	28.07
2024-03-10	20.61
2024-03-11	19.06
2024-03-12	29.48
2024-03-13	27.88
2024-03-14	26.21
2024-03-15	20.7
2024-03-16	7.25
2024-03-17	1.55
2024-03-18	4.76
2024-03-19	19.09
2024-03-20	30.67
2024-03-21	28.19
2024-03-22	12.18
2024-03-23	8.07
2024-03-24	6.95
2024-03-25	10.84
2024-03-26	13.12
2024-03-27	7.15
2024-03-28	5.74
2024-03-29	2.9
2024-03-30	7.6




Raport wygenerowano: 2024-05-09 14:14

Urządzenie:

Szkolna 2, Grupa SP

Pyły zawieszone o średnicy mniejszej niż 10 mikrometrów

Data	Wartość
2024-03-01	55.36
2024-03-02	49.07
2024-03-03	46.09
2024-03-04	41.87
2024-03-05	33.2
2024-03-06	40.24
2024-03-07	36.59
2024-03-08	52.17
2024-03-09	48.11
2024-03-10	35.89
2024-03-11	33.19
2024-03-12	50.97
2024-03-13	47.65
2024-03-14	44.81
2024-03-15	35.23
2024-03-16	12.77
2024-03-17	2.79
2024-03-18	8.44
2024-03-19	32.94
2024-03-20	51.79
2024-03-21	48.44
2024-03-22	21.42
2024-03-23	14.14
2024-03-24	12.39
2024-03-25	18.96
2024-03-26	22.91
2024-03-27	12.28
2024-03-28	10.25
2024-03-29	5.18
2024-03-30	13.39

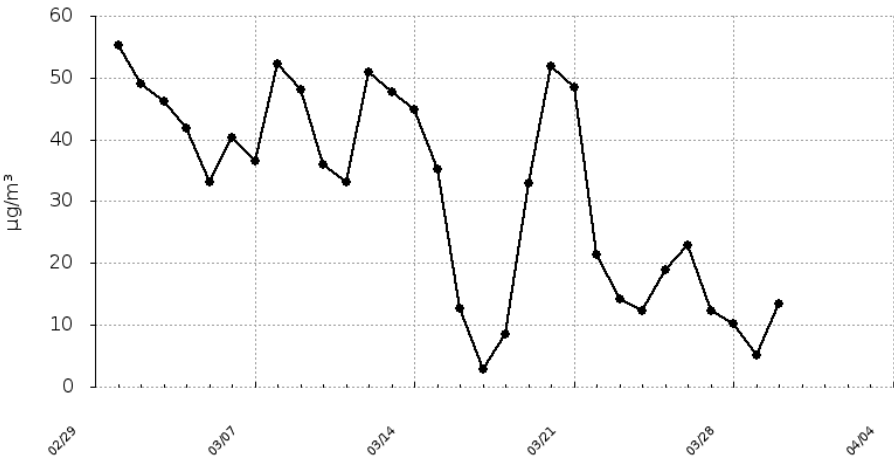


Urządzenie:

Szkolna 2, Grupa SP

Pyły zawieszone o średnicy mniejszej niż 1 mikrometr

Data	Wartość
2024-03-01	16.02
2024-03-02	14.25
2024-03-03	13.21
2024-03-04	12.07
2024-03-05	9.51
2024-03-06	11.71
2024-03-07	10.64
2024-03-08	15.12
2024-03-09	13.94
2024-03-10	10.36
2024-03-11	9.45
2024-03-12	14.73
2024-03-13	13.78
2024-03-14	12.94
2024-03-15	10.16
2024-03-16	3.67
2024-03-17	0.8
2024-03-18	2.42
2024-03-19	9.37
2024-03-20	14.98
2024-03-21	14.1
2024-03-22	6.06
2024-03-23	4.09
2024-03-24	3.49
2024-03-25	5.35
2024-03-26	6.49
2024-03-27	3.52
2024-03-28	2.9
2024-03-29	1.46
2024-03-30	3.86

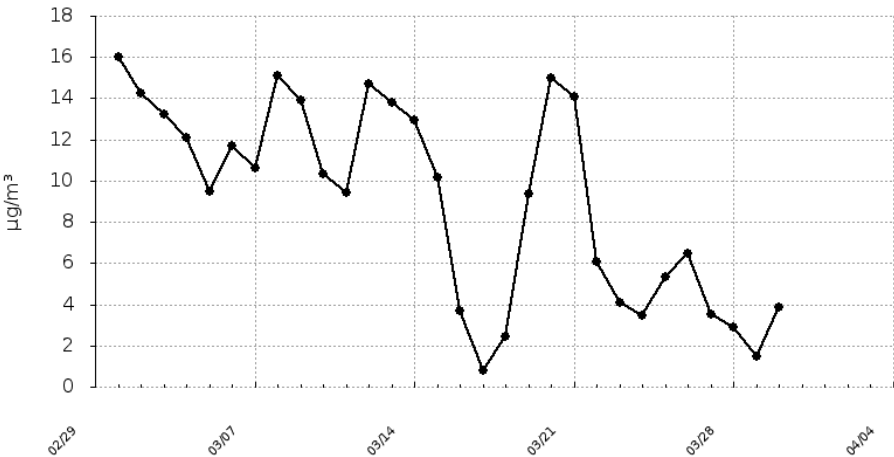

Raport wygenerowano: 2024-05-09 14:14